



GEC-Elliott Process Automation Limited


Xenon Lantern Type LX & LX Mk II

Components List

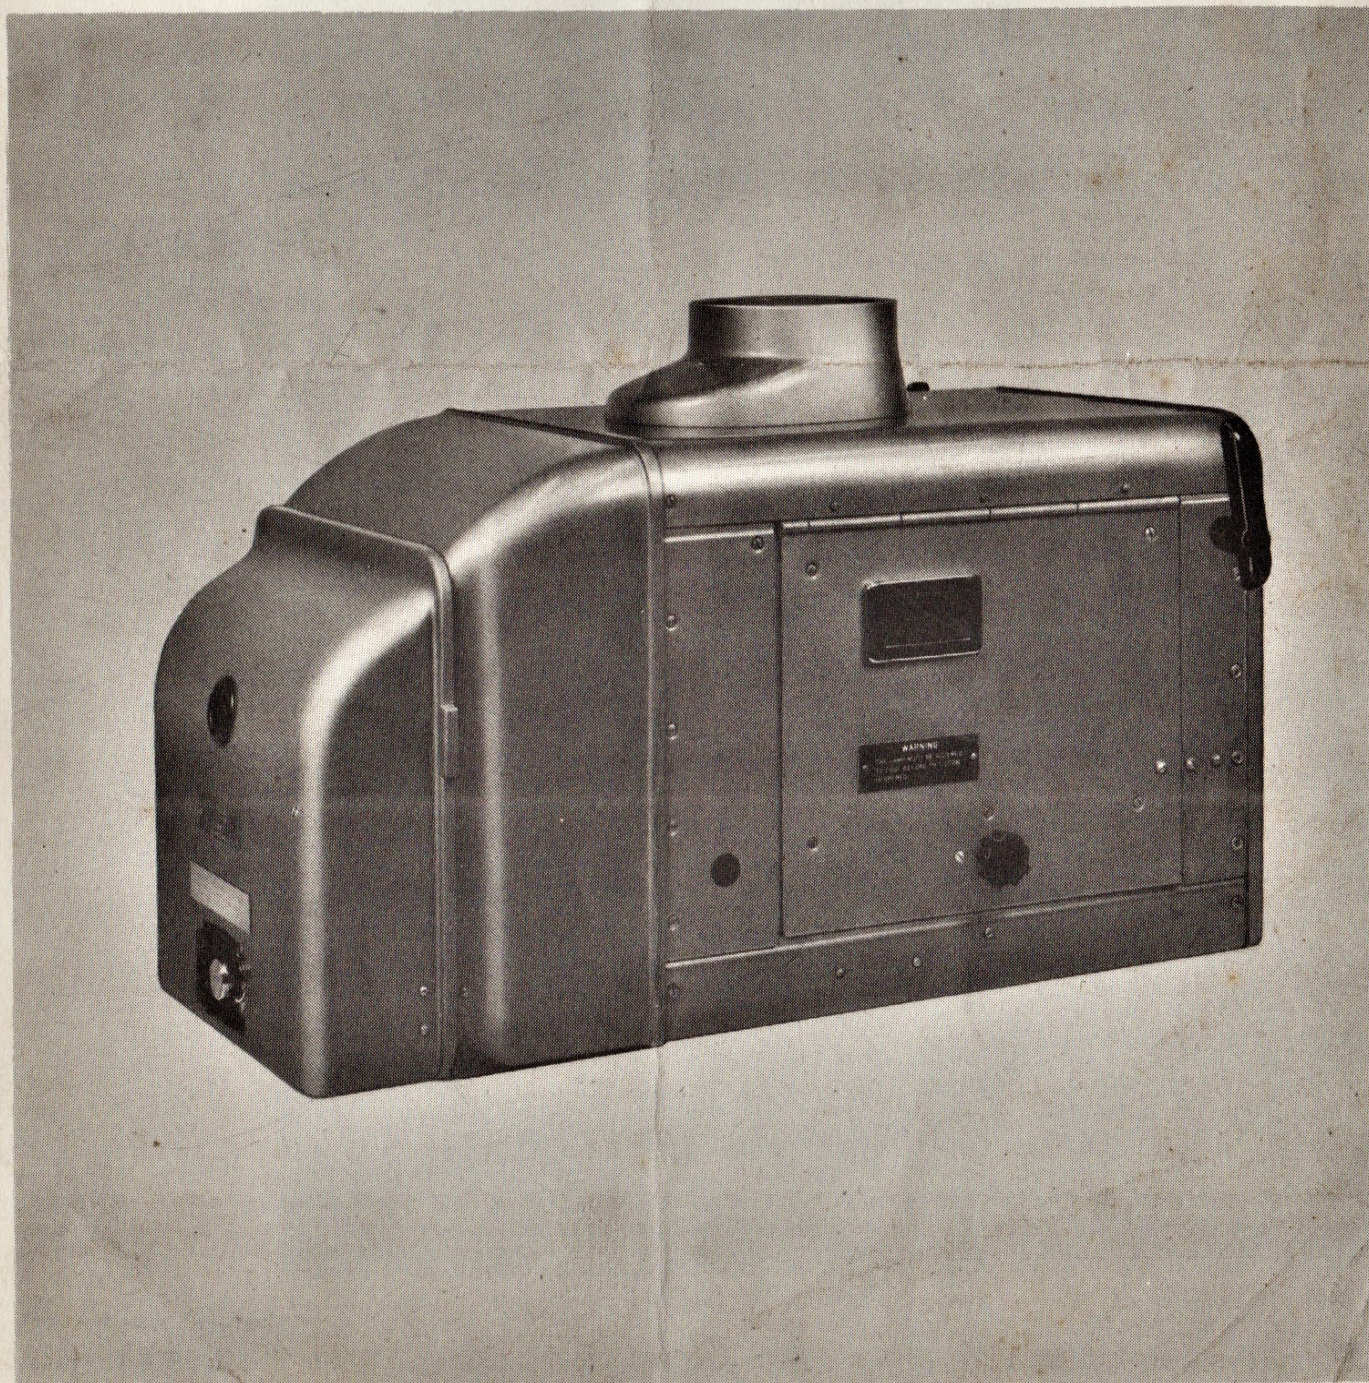

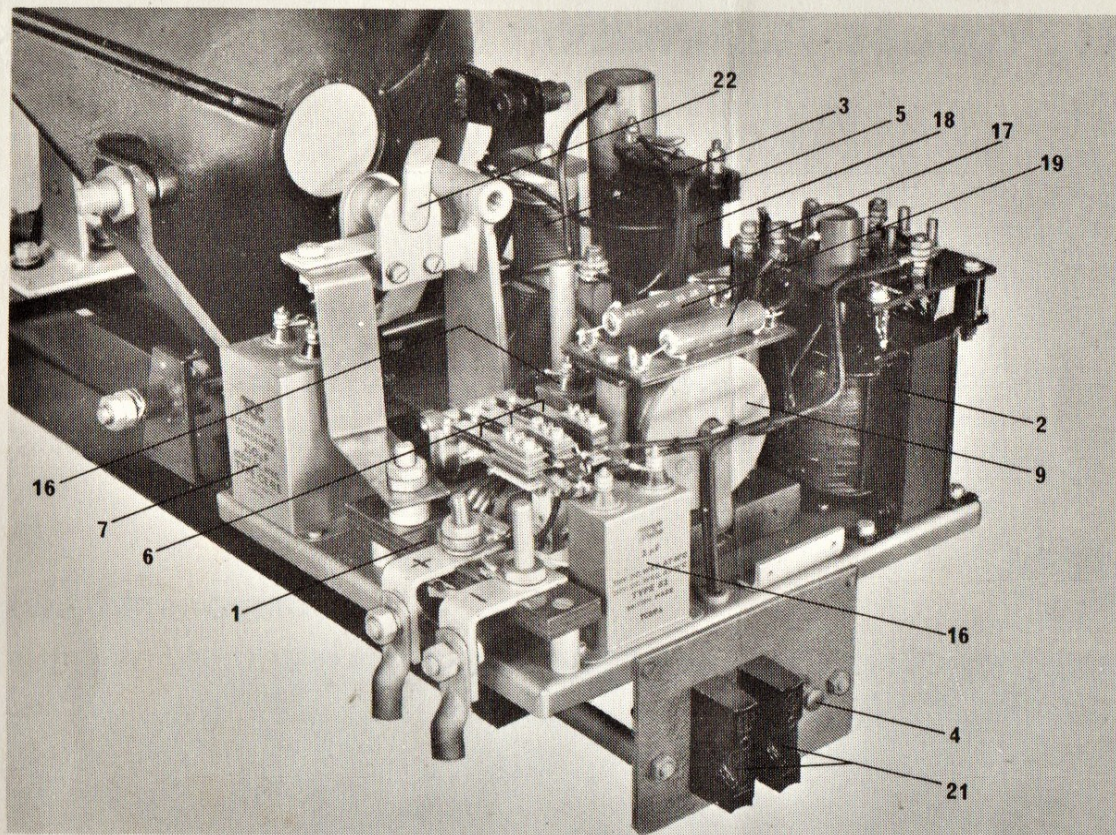


Strike unit for Xenon
Lantern type LX

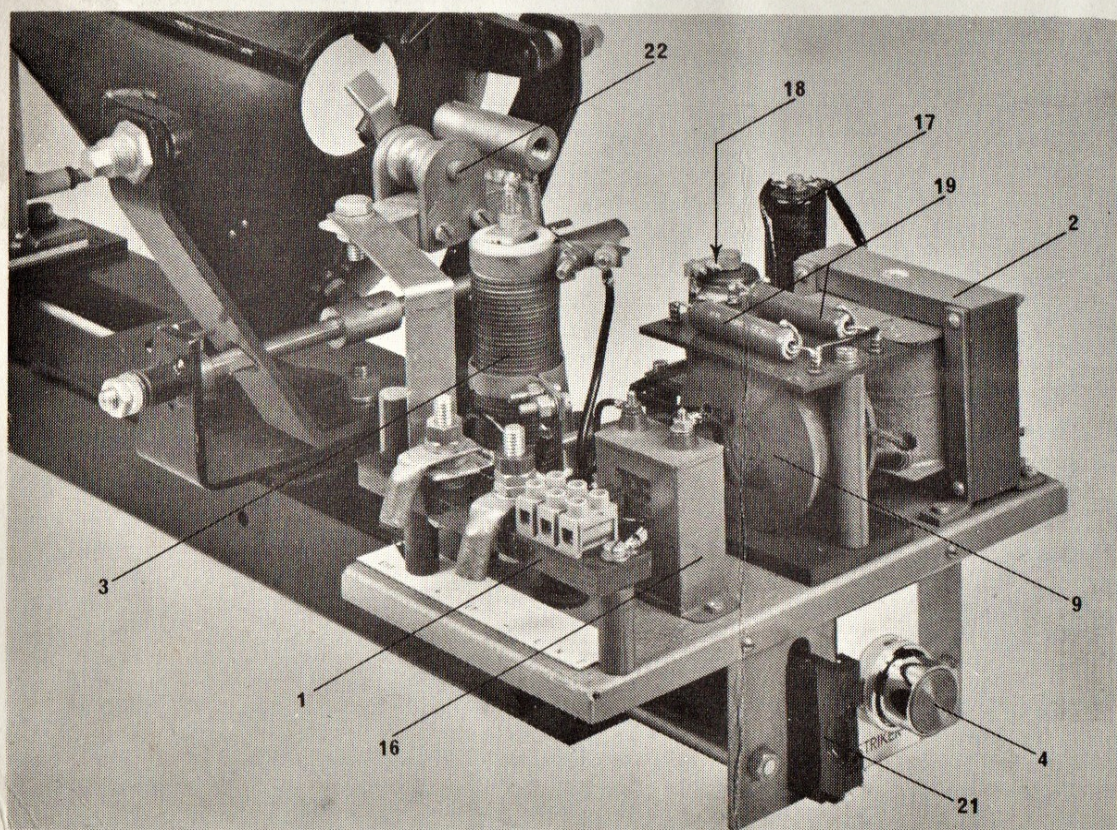

Strike unit for Xenon
Lantern type LX Mk II

Item	Type LX	Type LX Mark II
1 DC Terminal Insulation Board	SK 2367609-1	RRD 10582
2 AC Transformer	LSK 2367170-1 replaced by Y 2605795	Y 2605795
3 Strike Resistance	SK 2367438-1	RRD 10583
4 Strike Switch	Z 2367600	RRD 10584
5 Contacts for Delay Relay (pair)	Z 2449278	Not used
6 Relay Contacts (3 pairs)	1025 /51B	Not used
7 Condenser 250 mfd	Z 2367420	Not used
8 Shutter Disc	LSK 2367995	
9 Pulse Coil	FF 60540	
10 Negative Clamp Assembly	LMK 2449942-1	
11 Insulation Strip (fitted under neg. clamp)	Z 2367592	
12 Negative connection bar with nuts	Z 2367587	
13 Insulation support for neg. connection	Z 2367591	
14 Negative lead (80 amp flexible)	MK 2367876-1	
15 Mirror. Glass (not illustrated)	LSK 2367168-1	
16 Condenser 2 mfd	SK 2367603-2	
17 Condenser EHT .05 3kv	SK 2367603-3	
18 Spark Gap	DG 59, BS 210 or GD 2V	
19 Resistance 15K	Z 2367604	
20 Micro-Switch	Z 2367421	
21 Fuse Holder Fuse Carrier 15A	Z 2367605	
22 Positive Clamp Assembly	SK RRD 658 G1	
23 Ceramic Pillar. EHT	Z 2367228	
24 Shield for Neg. Clamp Assembly	LSK 2367863	
25 R.F. Suppressor Condenser not fitted		RRD 10585
26 Silicone Fluid 1 oz bottle	RRD 10586	Not required
27 Safety Goggles	RRD 10587	

ALWAYS QUOTE TYPE AND SERIAL NUMBER OF LANTERN WHEN ORDERING SPARES.

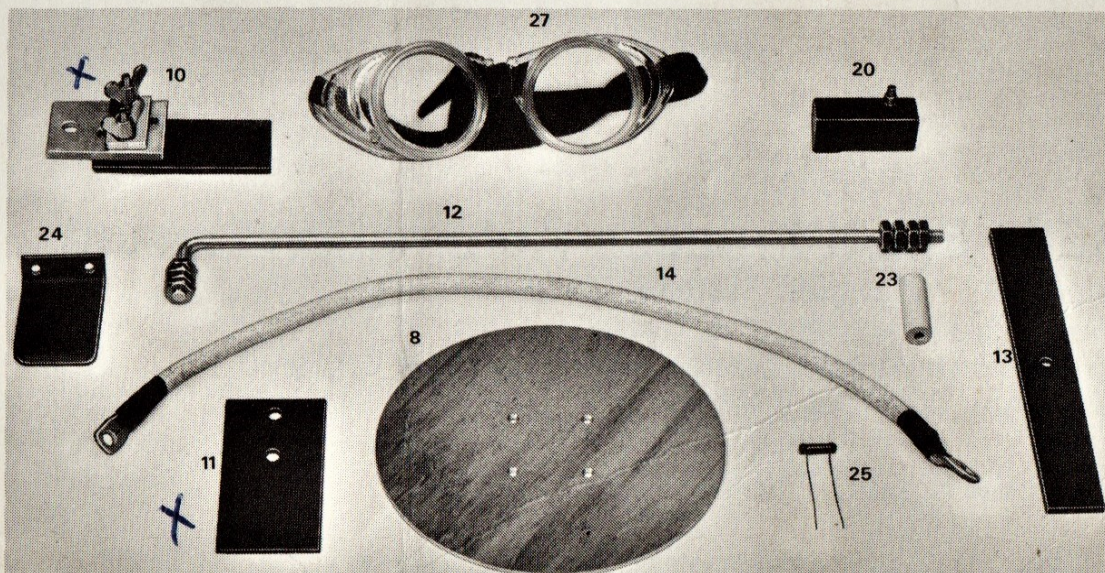

Spare parts for
Xenon Lanterns.

GEC-Elliott Process Automation Limited

Telemetry and Digital Systems Division

Sound Equipment Product Sales

4 Whitworth Street Manchester M1 3QW England

Telephone 061-236 6765/6

A member of GEC-Elliott Automation Group

Publication A 2004-40 Ed.A 500 0770 Printed in England NVPS/NP